1999 Average Lock Delay at Main Chambers
Delay Greater Than 1 Hour

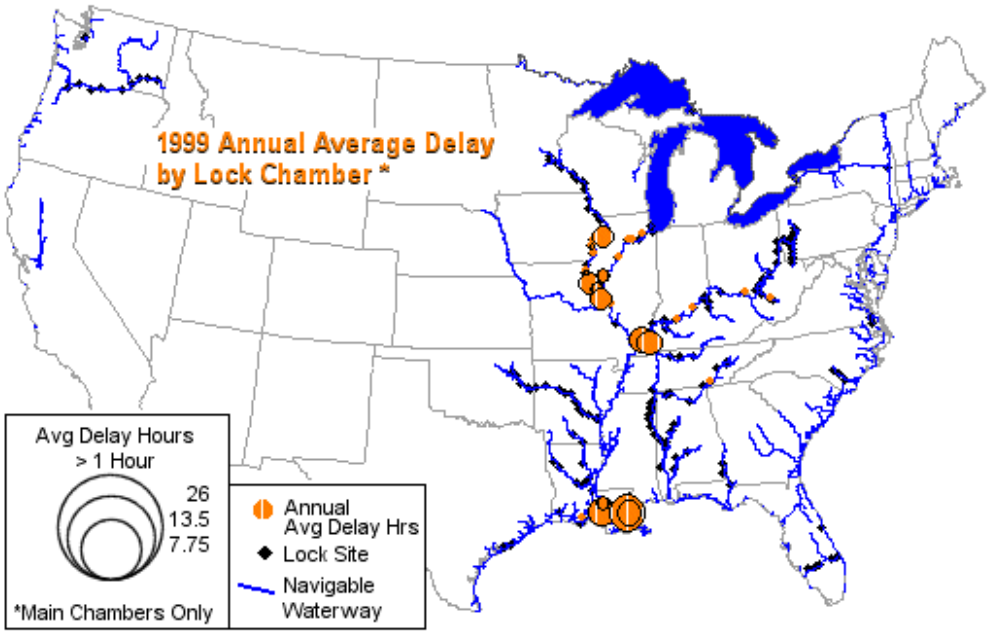

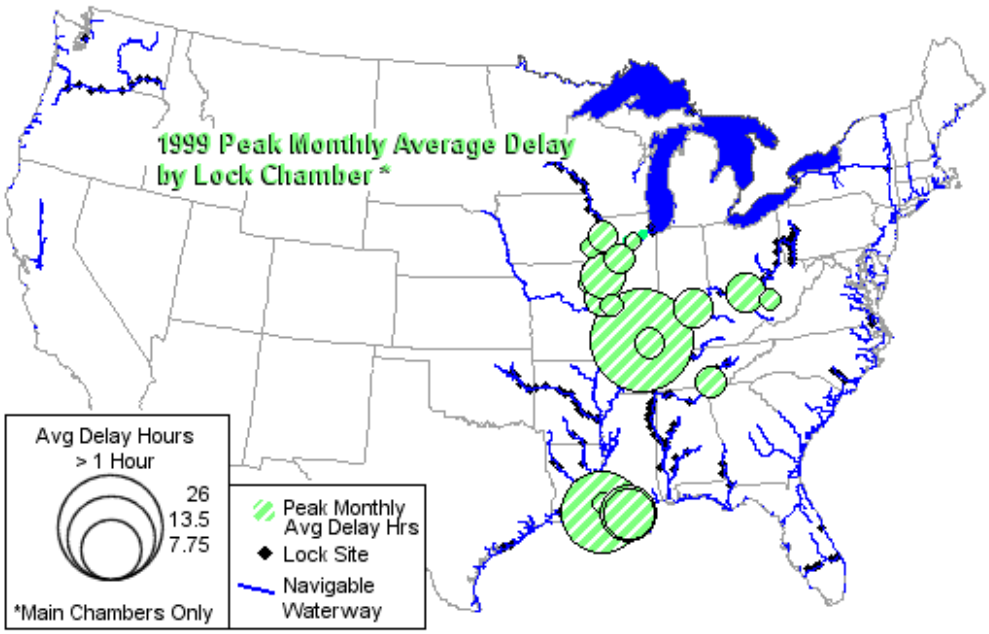

U.S. Army Corps of Engineers
Water Resources Support Center
Navigation Data Center

Source:1999 Lock Performance
Monitoring System